



Acme Manufacturing

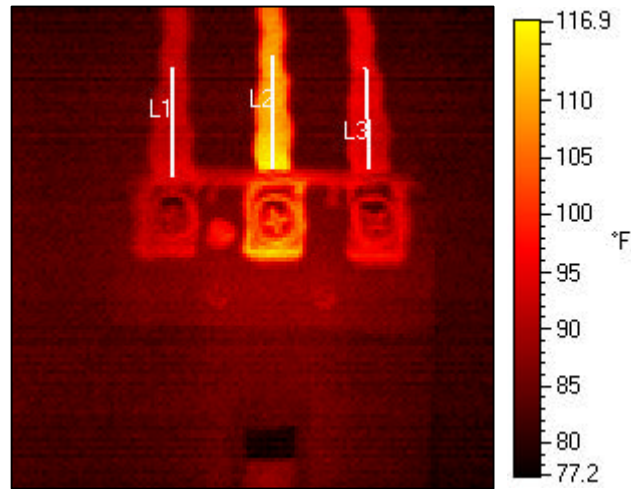

Hot Connect.isi

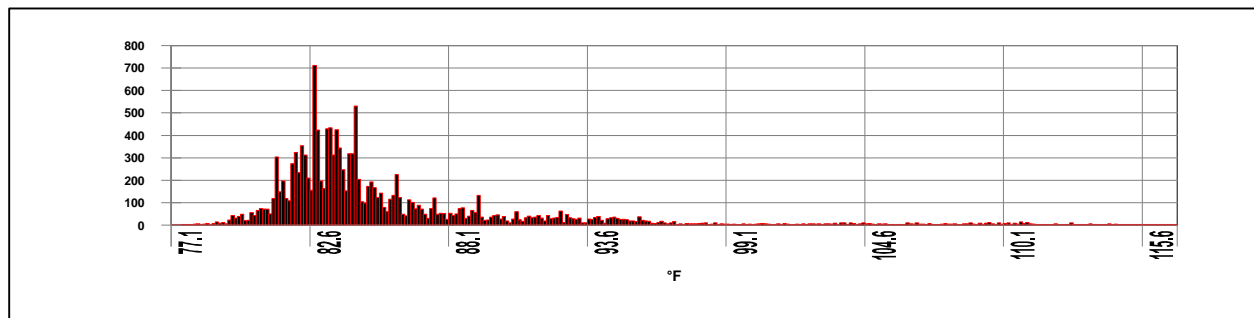

Info:

Image Path	E:\INFRARED SOLUTIONS\SNAPVIEWPRO2\SAMPLE IMAGES\Hot Connect.isi
Image Date/Time	Wednesday, December 16, 1998 2:25:25 PM
Report Date/Time	Monday, July 26, 1999 12:43:27 PM
Temp Unit	Fahrenheit
User	PM Supervisor K. Esterby
Location	Acme Manufacturing
Target	Connector 3516

Data:

Label	Emissivity	Background	Average	Std Dev	Max	Min
L1	0.97	76.96	92.6	1.31	95.2	90.4
L2	0.97	76.96	111.6	3.07	116.9	100.1
L3	0.97	76.96	94.7	0.83	96.6	92.5

Comments:

- Bi-monthly route of electrical connectors
- 2nd connection point found 20 degrees hotter than adjacent connections
- Referred to electrical department manager for immediate repair
- Tighten connection and re-image
- Add to next week's route